
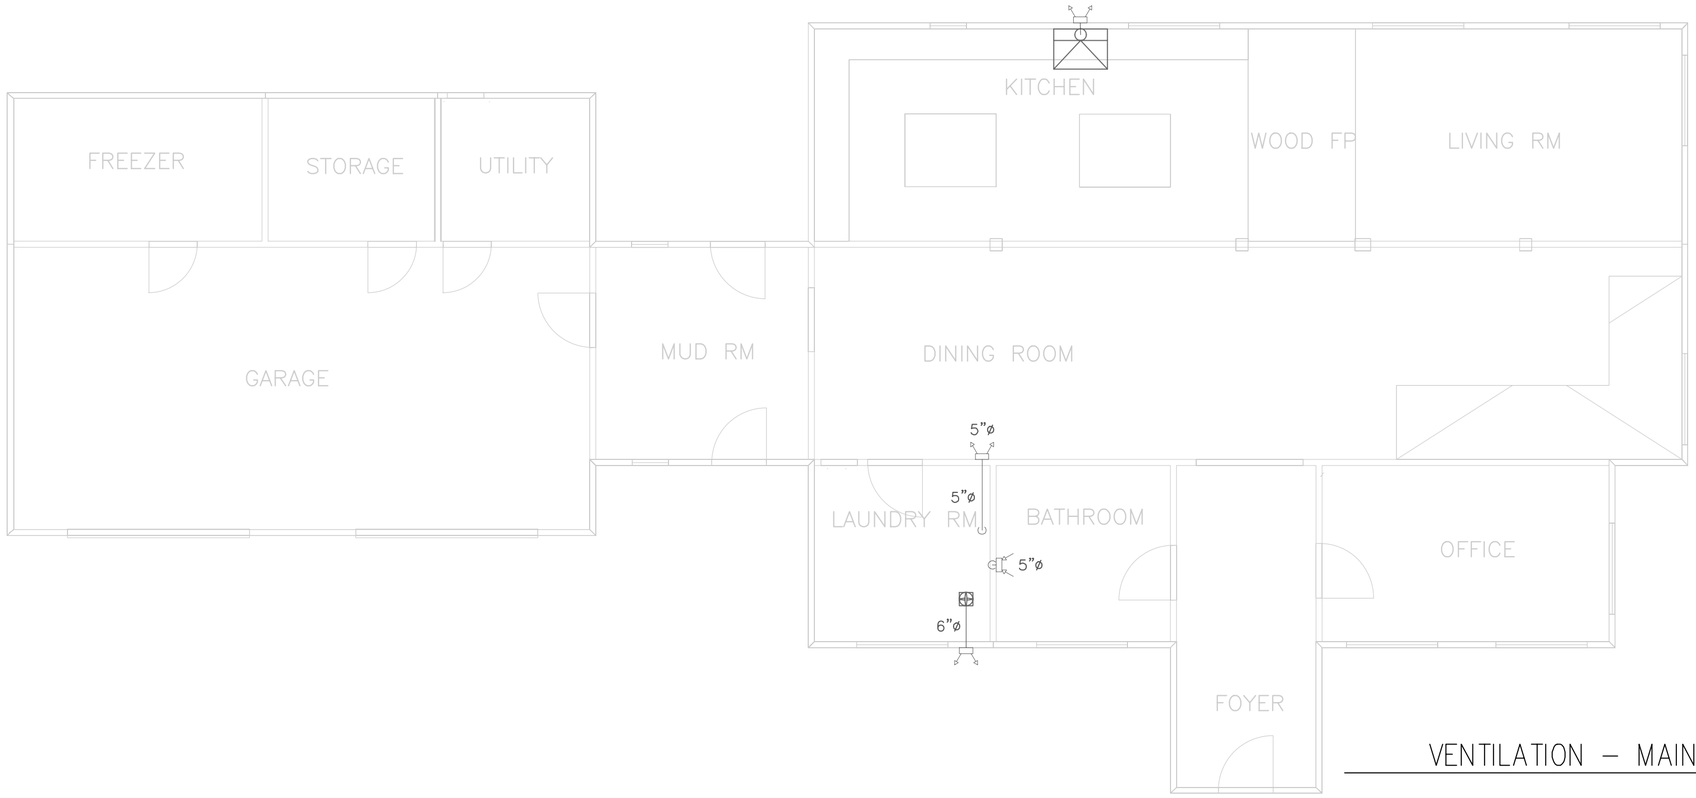


VENTILATION – MAIN FLOOR

SCALE:3/16" = 1'-0"

NOTES FOR THIS SHEET

1. HRVs – VANEE V150H75 OR EQUIVALENT
2. HRV TO BE INSTALLED BEHIND THE WALK–IN.
3. MINIMUM 10' SEPARATION OF HRV INTAKE AND EXHAUST OR PER MANUFACTURERS INSTRUCTIONS.
4. HRV INTAKE AND EXHAUST TO BE INSULATED FROM HOOD/LOUVRE CONTINUOUSLY TO ERV UNIT AND CONNECTED AS PER MANUFACTURERS INSTRUCTIONS.
5. HRVS TO BE INSTALLED TO ALLOW FOR REGULAR MAINTENANCE AND FILTER CLEANING.
6. ALL EXHAUST FANS VENTING TO BE COMPLETELY INSULATED AS PER OBC.

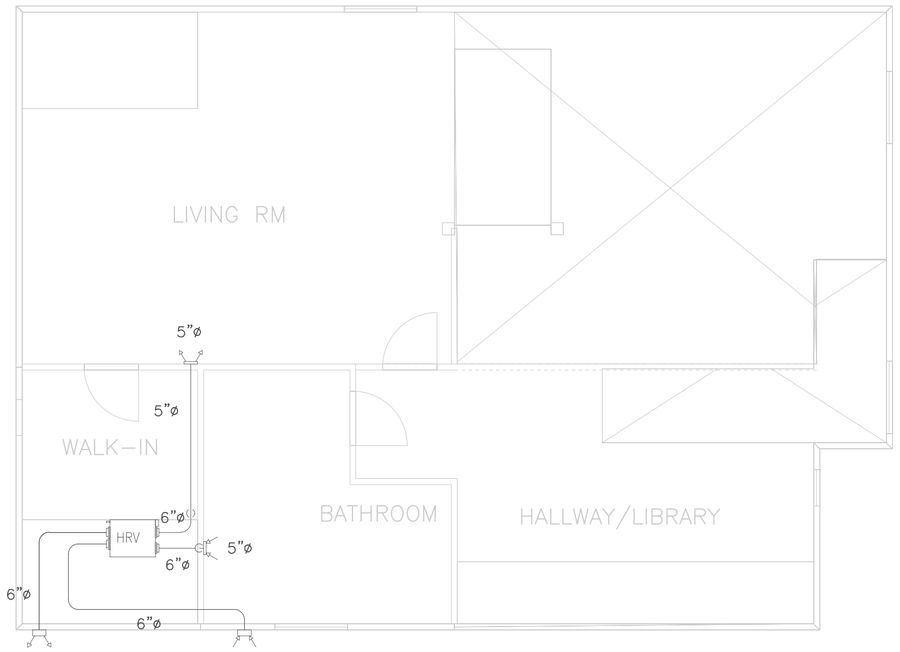

VENTILATION – SECOND FLOOR

SCALE:3/16" = 1'-0"

COOL CAT'S HVAC DESIGN
DESIGNS BY: CATLIN HOMER
BCIN: 46979
PO Box 215
Ayton, Ontario
N0G 1C0
289-260-3490
catlin@coolcatshvacdesign.com

Cool Cat's HVAC Design

802 Albert Street
Ayton, ON
289–260–3490
catlin@coolcatshvacdesign.com

Catlin Homer
BCIN# 46979

This drawing, as an instrument of service, is provided by and is the property of Cool Cat's HVAC Design and shall be used only for the project named on this drawing and solely for reference purposes only. The contractor is responsible for the coordination and verification of all dimensions contained herein and all measurements and conditions on site as they pertain to these documents. The contractor shall report any discrepancies to the consultant in writing prior to the commencement of any affected work.

Do not scale this drawing

This drawing shall not be used for construction purposes unless stamped.

No.	Issued for	Date

Project Address:
Sprucedale, ON

Project No.
Drawn by
Reviewed by
Scale

Ventilation

Drawing No:
M1.0